


Location		EPA Limit 0.020 mg/l
Pod 2C Drinking Fountain	0.0034	0.02
Commons Drinking Fountain	ND	0.02
Cafeteria Glass Filler	0.0072	0.02
Kitchen Triple Sink	0.0108	0.02



Location		EPA Limit 0.020 mg/l
New Weight Room Sink	ND	0.02
Senior Hall Restroom Sink	0.0028	0.02
Kitchen Triple Sink	ND	0.02
Southeast Drinking Fountain	0.003	0.02

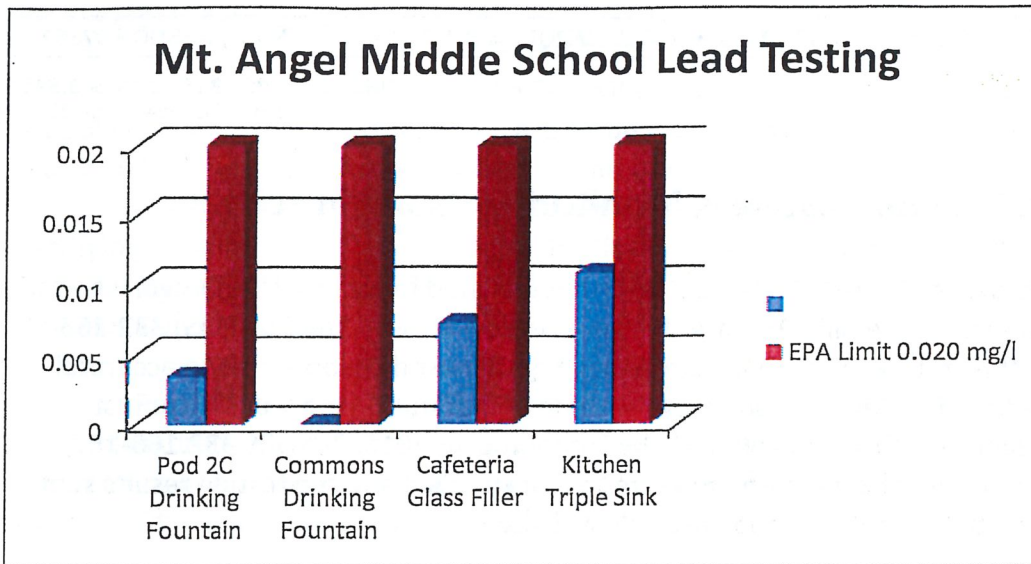